

Engraved Placard Examples

- Lettering should be 3/8 inches high on all placards
- Placards should have a red background with white lettering
- Sizing may be adjusted to fit Meter Base and AC Disconnect Switch



1.5 x 5.5

- This engraved label is to be on the Battery Disconnect



3 x 4.5


- This engraved label is to be on or next to the utility meter base



2 x 4

- This engraved label is to be on or next to the AC knife blade Disconnect for the solar system

IF a director placard is required:

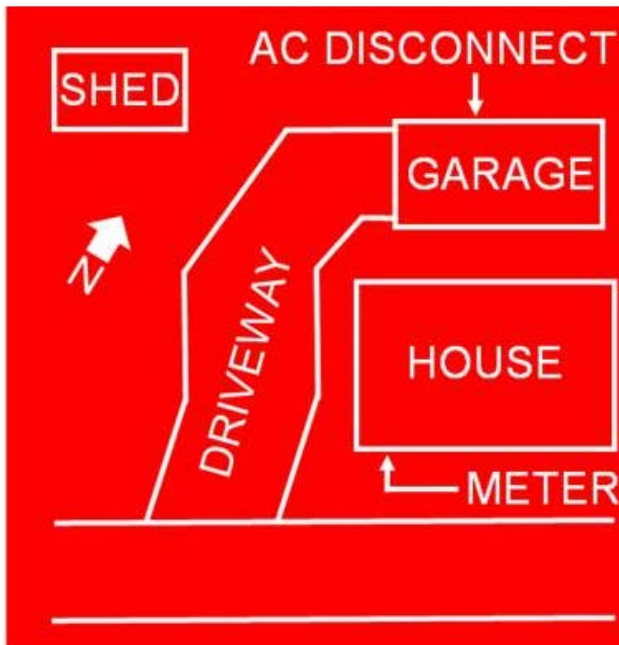

- Lettering should be at least 9mm tall (1/4 inch) tall, comparable to 25pt Arial font
- 5x5 inches, this size is for example only – use an overall size that promotes readability

5x5